

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106


1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Belgotex Floorcoverings  
Switchyard Bld 3, Warehouse 8  
161 Manchester Road  
Auburn NSW 2144

**Test Number :** 24-004520  
**Issue Date :** 14/01/2025  
**Print Date :** 14/01/2025

**Sample Description** Clients Ref : "Alexandria"  
Loop pile carpet tested on Dunlop Government Red Underlay  
End Use : Flooring  
Nominal Composition : 100% Solution Dyed Nylon  
Nominal Mass per Unit Area/Density : 2365g/m2  
Nominal Thickness : 11mm

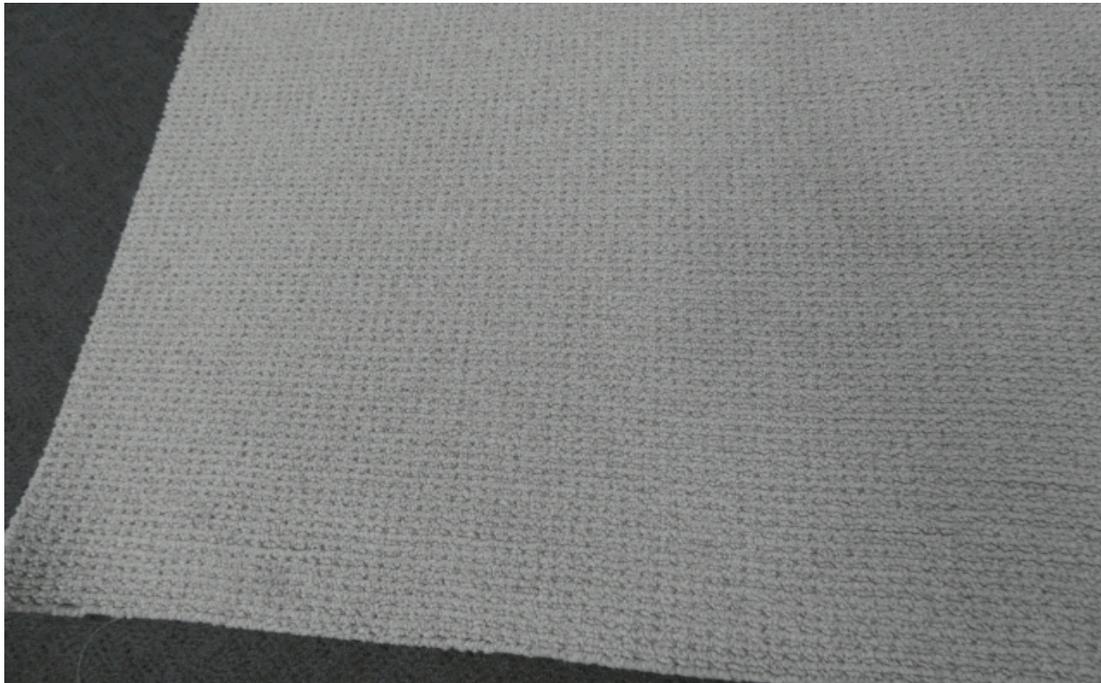

340142

74001

Page 1 of 2

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved

Samples, and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. The above test results are designed to provide THE CLIENT WITH GUIDANCE INFORMATION ONLY. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved in advance by the Managing Director of AWTA Ltd.



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR

# AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing  
A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031  
P.O Box 240, North Melbourne, Victoria 3051  
Phone (03) 9371 2400

## TEST REPORT

**Client :** Belgotex Floorcoverings  
Switchyard Bld 3, Warehouse 8  
161 Manchester Road  
Auburn NSW 2144

**Test Number :** 24-004520  
**Issue Date :** 14/01/2025  
**Print Date :** 14/01/2025

**AS ISO 9239.1-2003  
(Modified Guidance)**

**Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a  
Radiant Heat Source**

Date of Sample Arrival 11-11-2024  
Date Tested 14-11-2025

HF-30 Value  
Width 2.3 kW/m<sup>2</sup>  
Width 144 %.min  
Melting Yes  
Penetration of flame through to substrate Yes

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing.

Each specimen was loose laid over Dunlop - Government Red underlay and 6mm thick fibre reinforced cement board and clamped prior to testing.

340142

74001

Page 2 of 2

© Australian Wool testing Authority Ltd  
Copyright - All Rights Reserved

Samples, and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. The above test results are designed to provide THE CLIENT WITH GUIDANCE INFORMATION ONLY. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved in advance by the Managing Director of AWTA Ltd



Fiona McDonald

APPROVED SIGNATORY

MICHAEL A. JACKSON B.Sc.(Hons)  
MANAGING DIRECTOR